




## Indicator light, compact, raised, yellow

**Part no.** M22-LCH-Y  
**Catalog No.** 216917  
**Eaton Catalog No.** M22-LCH-YQ  
**EL-Nummer** 4355444  
**(Norway)**

### Delivery program

|   |   |  |   |
|---|---|--|---|
| Product range   |   |  | RMQ-Titan   |
| Basic function  |   |  | Indicator lights  |
| Single unit/Complete unit   |   |  | Complete unit   |
| Design  |   |  | Extended, conical   |
| Description   |   |  | without light elements<br>For filament bulbs, neon bulbs and LEDs up to 2.4 W<br>with BA 9s lamp socket |
| <b>Colour</b>   |   |  |   |
| Lens  |   |  | yellow  |
| Lens  |   |  |                       |
| Degree of Protection  |   |  | IP67, IP69K   |
| Connection to SmartWire-DT  |   |  | no  |
| <b>Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1</b> |   |  |   |
| Minimum force for positive opening  | N |  | 0   |
| Front dimensions  |   |  | 29,7  |

### Technical data

#### General

|                             |  |                 |  |
|-----------------------------|--|-----------------|--|
| Standards                   |  |                 | IEC/EN 60947<br>VDE 0660   |
| Climatic proofing           |  |                 | Damp heat, constant, to IEC 60068-2-78<br>Damp heat, cyclic, to IEC 60068-2-30 |
| Degree of Protection        |  |                 | IP67, IP69K  |
| Ambient temperature         |  |                 |  |
| Open                        |  | °C              | -25 - +70  |
| Mounting position           |  |                 | As required  |
| Mechanical shock resistance |  | g               | 30<br>Shock duration 11 ms<br>Sinusoidal<br>according to IEC 60068-2-27        |
| Terminal capacities         |  | mm <sup>2</sup> |  |
| Solid                       |  | mm <sup>2</sup> | 0.5 - 1.5  |
| Stranded                    |  | mm <sup>2</sup> | 0.5 - 1.5  |

#### Contacts

|                                       |           |      |       |
|---------------------------------------|-----------|------|-------|
| Rated impulse withstand voltage       | $U_{imp}$ | V AC | 4000  |
| Rated insulation voltage              | $U_i$     | V    | 250   |
| Overvoltage category/pollution degree |           |      | III/3 |

### Design verification as per IEC/EN 61439

|  |           |   |   |
|--|-----------|---|---|
| Technical data for design verification                   |           |   |   |
| Rated operational current for specified heat dissipation | $I_n$     | A | 0 |
| Heat dissipation per pole, current-dependent             | $P_{vid}$ | W | 0 |
| Equipment heat dissipation, current-dependent            | $P_{vid}$ | W | 0 |
| Static heat dissipation, non-current-dependent           | $P_{vs}$  | W | 0 |

|  |                   |    |  |
|--|-------------------|----|--|
| Heat dissipation capacity  | P <sub>diss</sub> | W  | 0  |
| Operating ambient temperature min.   |                   | °C | -25  |
| Operating ambient temperature max.   |                   | °C | 70   |
| IEC/EN 61439 design verification   |                   |    |  |
| 10.2 Strength of materials and parts   |                   |    |  |
| 10.2.2 Corrosion resistance  |                   |    | Meets the product standard's requirements.   |
| 10.2.3.1 Verification of thermal stability of enclosures   |                   |    | Meets the product standard's requirements.   |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat   |                   |    | Meets the product standard's requirements.   |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |                   |    | Meets the product standard's requirements.   |
| 10.2.4 Resistance to ultra-violet (UV) radiation   |                   |    | Please enquire   |
| 10.2.5 Lifting   |                   |    | Does not apply, since the entire switchgear needs to be evaluated.                                       |
| 10.2.6 Mechanical impact   |                   |    | Does not apply, since the entire switchgear needs to be evaluated.                                       |
| 10.2.7 Inscriptions  |                   |    | Meets the product standard's requirements.   |
| 10.3 Degree of protection of ASSEMBLIES  |                   |    | Does not apply, since the entire switchgear needs to be evaluated.                                       |
| 10.4 Clearances and creepage distances   |                   |    | Meets the product standard's requirements.   |
| 10.5 Protection against electric shock   |                   |    | Does not apply, since the entire switchgear needs to be evaluated.                                       |
| 10.6 Incorporation of switching devices and components   |                   |    | Does not apply, since the entire switchgear needs to be evaluated.                                       |
| 10.7 Internal electrical circuits and connections  |                   |    | Is the panel builder's responsibility.   |
| 10.8 Connections for external conductors   |                   |    | Is the panel builder's responsibility.   |
| 10.9 Insulation properties   |                   |    |  |
| 10.9.2 Power-frequency electric strength   |                   |    | Is the panel builder's responsibility.   |
| 10.9.3 Impulse withstand voltage   |                   |    | Is the panel builder's responsibility.   |
| 10.9.4 Testing of enclosures made of insulating material   |                   |    | Is the panel builder's responsibility.   |
| 10.10 Temperature rise   |                   |    | Not applicable.  |
| 10.11 Short-circuit rating   |                   |    | Is the panel builder's responsibility. The specifications for the switchgear must be observed.           |
| 10.12 Electromagnetic compatibility  |                   |    | Is the panel builder's responsibility. The specifications for the switchgear must be observed.           |
| 10.13 Mechanical function  |                   |    | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

## Technical data ETIM 6.0

Low-voltage industrial components (EG000017) / Front element for indicator light (EC000223)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Command and alarm device / Front element for warning lights (ecl@ss8.1-27-37-12-11 [AKF029011])

|   |  |    |         |
|---|--|----|---------|
| Suitable for number of built-in signal lights |  |    | 1       |
| Colour lens                                   |  |    | Yellow  |
| Construction type lens                        |  |    | Round   |
| Hole diameter                                 |  | mm | 22.5    |
| Width opening                                 |  | mm | 0       |
| Height meter opening                          |  | mm | 0       |
| With front ring                               |  |    | No      |
| Material front ring                           |  |    | Plastic |
| Colour front ring                             |  |    | -       |
| Type of lens                                  |  |    | High    |
| Degree of protection (IP), front side         |  |    | -       |

## Approvals

|                             |  |  |   |
|-----------------------------|--|--|---|
| Product Standards           |  |  | IEC/EN 60947-5; UL 508; CSA-C22.2 No. 14-05; CE marking |
| UL File No.                 |  |  | E29184  |
| UL Category Control No.     |  |  | NKCR  |
| CSA File No.                |  |  | 012528  |
| CSA Class No.               |  |  | 3211-03   |
| North America Certification |  |  | UL listed, CSA certified                                |
| Degree of Protection        |  |  | UL/CSA Type 3R, 4X, 12, 13                              |

## Dimensions

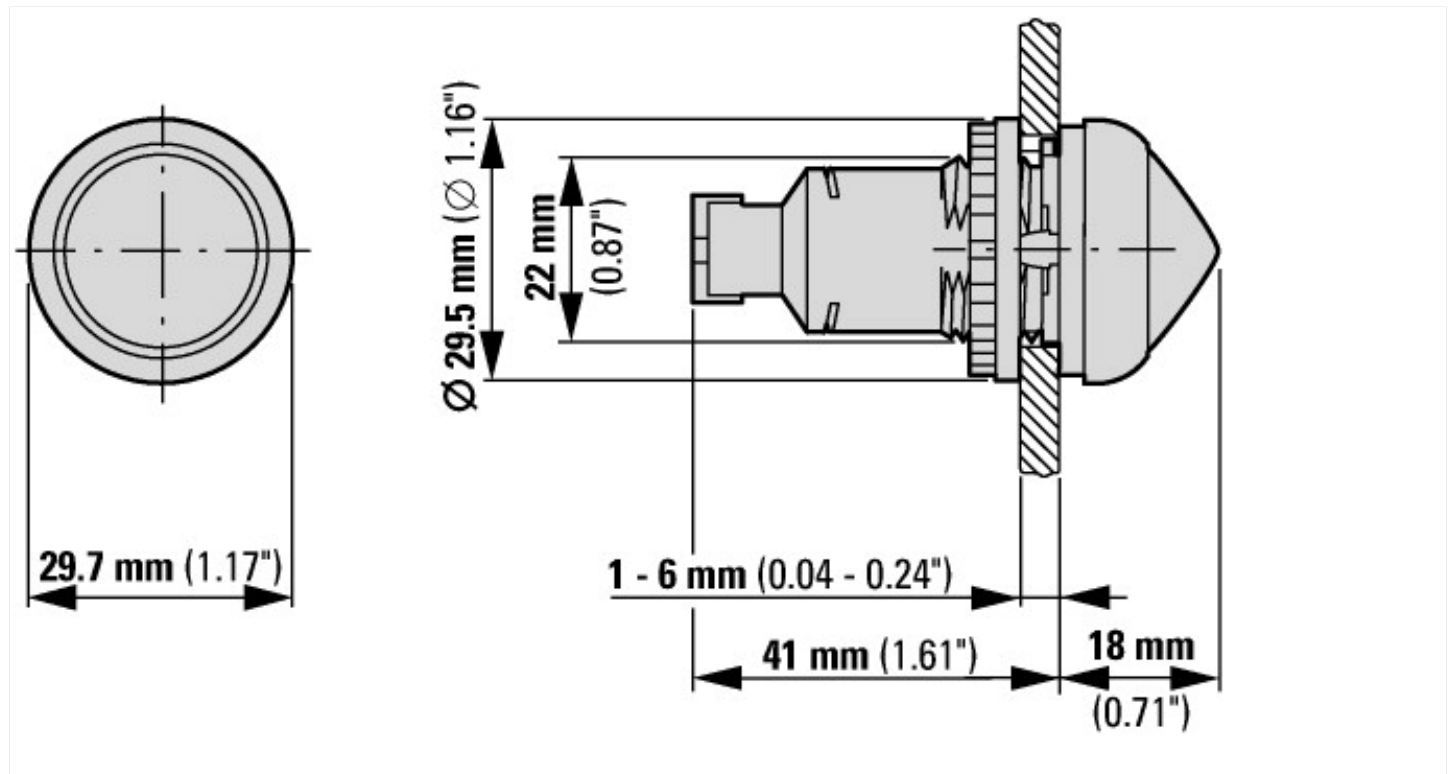

## Additional product information (links)

IL04716002Z (AWA1160-1745) RMQ-Titan System

IL04716002Z (AWA1160-1745) RMQ-Titan System

[ftp://ftp.moeller.net/DOCUMENTATION/AWA\\_INSTRUCTIONS/IL04716002Z2017\\_01.pdf](ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL04716002Z2017_01.pdf)