



Insulated enclosure, IP55\_x, rotary handle red yellow, for PKZ0

Part no. **CI-PKZ0-GRM**  
Catalog No. **260104**

## Delivery program

|                                                                                               |  |                                                                                           |
|-----------------------------------------------------------------------------------------------|--|-------------------------------------------------------------------------------------------|
| Product range                                                                                 |  | Accessories                                                                               |
| Subrange                                                                                      |  | Surface mounting enclosures                                                               |
| Accessories                                                                                   |  | Insulated enclosures for PKZ                                                              |
|                                                                                               |  | with red-yellow rotary knob, for use as EMERGENCY STOP switch in accordance with EN 60204 |
| Degree of Protection                                                                          |  | IP55                                                                                      |
| For use with                                                                                  |  | PKZM0-...<br>+NHI-E<br>+NHI or U or A<br>+L-PKZ0 (2 off)                                  |
| <b>Notes</b>                                                                                  |  |                                                                                           |
| Integrated terminal for PE(N) connection, two M25 cable entry knockouts at top and at bottom. |  |                                                                                           |

## Design verification as per IEC/EN 61439

|                                                                                                                        |            |    |                                                                                                                                  |
|------------------------------------------------------------------------------------------------------------------------|------------|----|----------------------------------------------------------------------------------------------------------------------------------|
| Technical data for design verification                                                                                 |            |    |                                                                                                                                  |
| Rated operational current for specified heat dissipation                                                               | $I_n$      | A  | 0                                                                                                                                |
| Heat dissipation per pole, current-dependent                                                                           | $P_{vid}$  | W  | 0                                                                                                                                |
| Equipment heat dissipation, current-dependent                                                                          | $P_{vid}$  | W  | 0                                                                                                                                |
| Static heat dissipation, non-current-dependent                                                                         | $P_{vs}$   | W  | 0                                                                                                                                |
| Heat dissipation capacity                                                                                              | $P_{diss}$ | W  | 10                                                                                                                               |
| Operating ambient temperature min.                                                                                     |            | °C | -25                                                                                                                              |
| Operating ambient temperature max.                                                                                     |            | °C | 70                                                                                                                               |
| IEC/EN 61439 design verification                                                                                       |            |    |                                                                                                                                  |
| 10.2 Strength of materials and parts                                                                                   |            |    |                                                                                                                                  |
| 10.2.2 Corrosion resistance                                                                                            |            |    | Meets the product standard's requirements.                                                                                       |
| 10.2.3.1 Verification of thermal stability of enclosures                                                               |            |    | Meets the product standard's requirements.                                                                                       |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat                                             |            |    | Meets the product standard's requirements.                                                                                       |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |            |    | Meets the product standard's requirements.                                                                                       |
| 10.2.4 Resistance to ultra-violet (UV) radiation                                                                       |            |    | Please enquire                                                                                                                   |
| 10.2.5 Lifting                                                                                                         |            |    | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.2.6 Mechanical impact                                                                                               |            |    | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.2.7 Inscriptions                                                                                                    |            |    | Meets the product standard's requirements.                                                                                       |
| 10.3 Degree of protection of ASSEMBLIES                                                                                |            |    | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.4 Clearances and creepage distances                                                                                 |            |    | Meets the product standard's requirements.                                                                                       |
| 10.5 Protection against electric shock                                                                                 |            |    | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.6 Incorporation of switching devices and components                                                                 |            |    | Does not apply, since the entire switchgear needs to be evaluated.                                                               |
| 10.7 Internal electrical circuits and connections                                                                      |            |    | Is the panel builder's responsibility.                                                                                           |
| 10.8 Connections for external conductors                                                                               |            |    | Is the panel builder's responsibility.                                                                                           |
| 10.9 Insulation properties                                                                                             |            |    |                                                                                                                                  |
| 10.9.2 Power-frequency electric strength                                                                               |            |    | Is the panel builder's responsibility.                                                                                           |
| 10.9.3 Impulse withstand voltage                                                                                       |            |    | Is the panel builder's responsibility.                                                                                           |
| 10.9.4 Testing of enclosures made of insulating material                                                               |            |    | Is the panel builder's responsibility.                                                                                           |
| 10.10 Temperature rise                                                                                                 |            |    | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating                                                                                             |            |    | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |

|                                     |  |                                                                                                          |
|-------------------------------------|--|----------------------------------------------------------------------------------------------------------|
| 10.12 Electromagnetic compatibility |  | Is the panel builder's responsibility. The specifications for the switchgear must be observed.           |
| 10.13 Mechanical function           |  | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

## Technical data ETIM 6.0

Low-voltage industrial components (EG000017) / Empty enclosure for switchgear (EC000712)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Component for low-voltage switching technology / Empty housing for switch devices (ec1@ss8.1-27-37-13-01 [AKN343011])


|                             |    |                  |
|-----------------------------|----|------------------|
| Material housing            |    | Plastic          |
| Width                       | mm | 80               |
| Height                      | mm | 160              |
| Depth                       | mm | 97               |
| With transparent cover      |    | No               |
| Suitable for emergency stop |    | Yes              |
| Model                       |    | Surface mounting |
| Degree of protection (IP)   |    | IP55             |

## Approvals

|                                      |  |    |
|--------------------------------------|--|----|
| Specially designed for North America |  | No |
|--------------------------------------|--|----|

## Dimensions

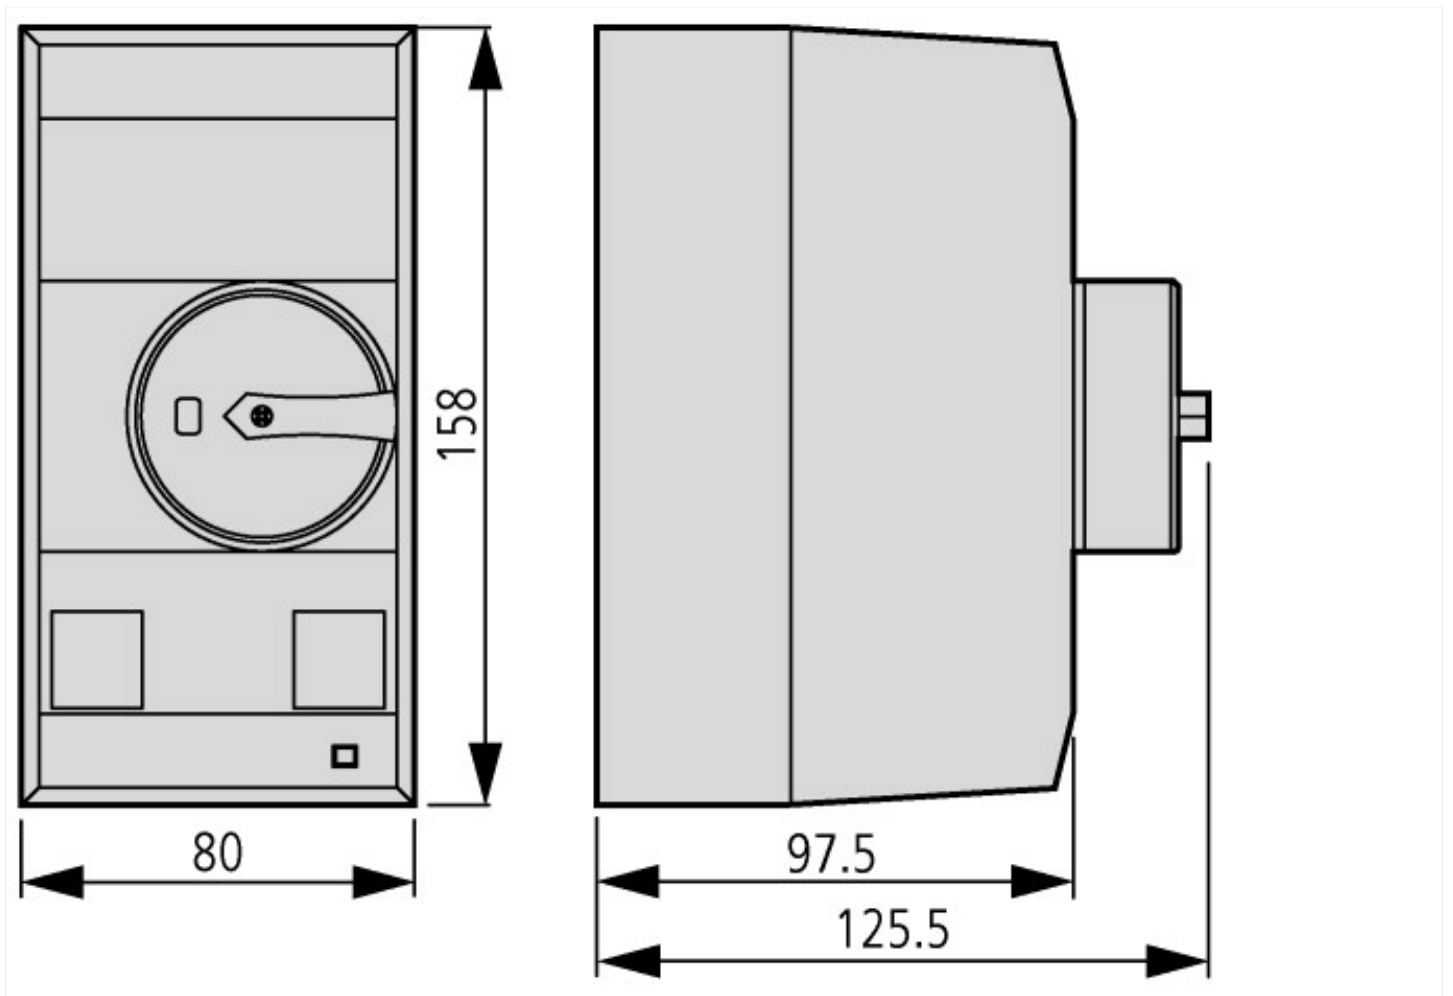

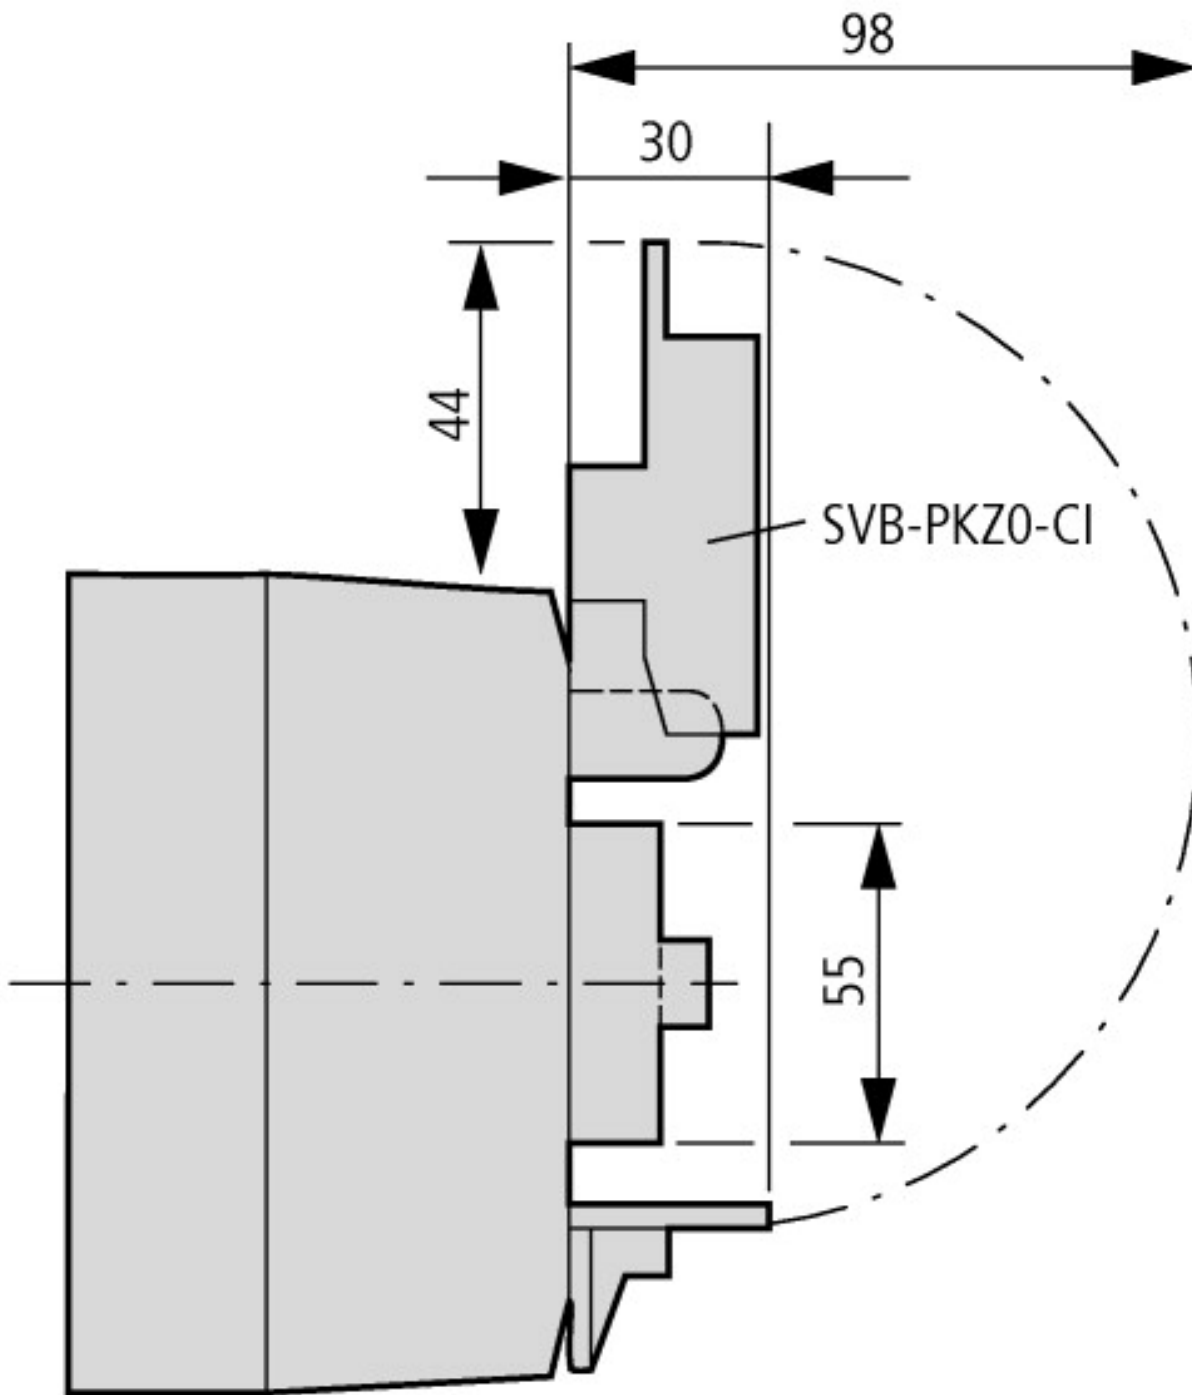

CI-K2-PKZ0-...M + SVB-PKZ0-CI

## Additional product information (links)

**IL03407019Z (AWA1210-1326) Insulated enclosure for surface mounting of Motor-protective circuit-breakers; Main switches, Emergency stop; Locking**

IL03407019Z (AWA1210-1326) Insulated enclosure for surface mounting of Motor-protective circuit-breakers; Main switches, Emergency stop; Locking

[ftp://ftp.moeller.net/DOCUMENTATION/AWA\\_INSTRUCTIONS/IL03407019Z2010\\_10.pdf](ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL03407019Z2010_10.pdf)

Motor starters and "Special Purpose Ratings" for the North American market

[http://www.moeller.net/binary/ver\\_techpapers/ver953en.pdf](http://www.moeller.net/binary/ver_techpapers/ver953en.pdf)

Busbar Component Adapters for modern Industrial control panels

[http://www.moeller.net/binary/ver\\_techpapers/ver960en.pdf](http://www.moeller.net/binary/ver_techpapers/ver960en.pdf)