



Remote operator, 380-440VAC, for size 2

Part no. **NZM2-XR380-440AC**
 Catalog No. **259834**

Similar to illustration

Delivery program

Product range			Accessories
Accessories			Remote operator, can be synchronized
Rated operating frequency			AC 50/60 Hz
Standard/Approval			IEC
Construction size			NZM2
Description			<p>For remote switching of circuit-breakers and switch-disconnectors.</p> <p>ON and OFF switching and resetting by means of two-wire or three-wire control.</p> <p>Local switching by hand possible.</p> <p>Lockable in the 0 position of the remote operator with up to 3 padlocks (hasp thickness: 4 – 8 mm)</p> <p>Can be synchronized</p> <p>Three-wire control</p> <p>Two-wire control</p> <p>Three-wire control with automatic reset to the 0 position after the switch has tripped</p> <p>Switching cycle:</p> <p>NZM2-XR </p> <p>NZM3-XR </p> <p>NZM4-XR </p> <p>The time interval between OFF and ON is 3 seconds. On commands received during the time interval are ignored within the first 3 seconds after switch off.</p> <p>Parallel remote operator connection</p>
Closing delay		ms	60
Break time		ms	300
Rated control voltage	U_s	V	380 - 440 V 50/60 Hz
Number of poles			3/4 pole
For use with			NZM2(-4)

Project planning information		N(S)2(-4) Cannot be combined with switch-disconnector PN... Do not install M22-CK11(20/02) dual auxiliary contacts in the center auxiliary contact slot in NZM2-XRD
Engineering information (sheet catalog)		2/3-wire control and circuit diagrams

Technical data

Remote operator

Rated control voltage	U _s	V	
AC	U _s	V AC	380 - 440
Operating range			
AC		x U _s	0.85 - 1.1
DC		x U _s	0.85 - 1.1
Motor rating			
AC			
110 V ... 130 V AC	S	VA	350
Minimum signal duration			
with switch on		ms	30
with switch off		ms	150
Lifespan, mechanical	Operations		20000
Maximum operating frequency		Ops/h	
Max. operating frequency		Ops/h	120
Terminal capacities		mm ²	
Solid or flexible conductor, with ferrule		mm ²	0,75 - 2,5
		AWG	18 ... 14


Design verification as per IEC/EN 61439

IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

Technical data ETIM 6.0

Type of switch drive		Motor drive
Rated control supply voltage U_s at AC 50HZ	V	380 - 440
Rated control supply voltage U_s at AC 60HZ	V	380 - 440
Rated control supply voltage U_s at DC	V	0 - 0
Voltage type for actuating		AC

Dimensions

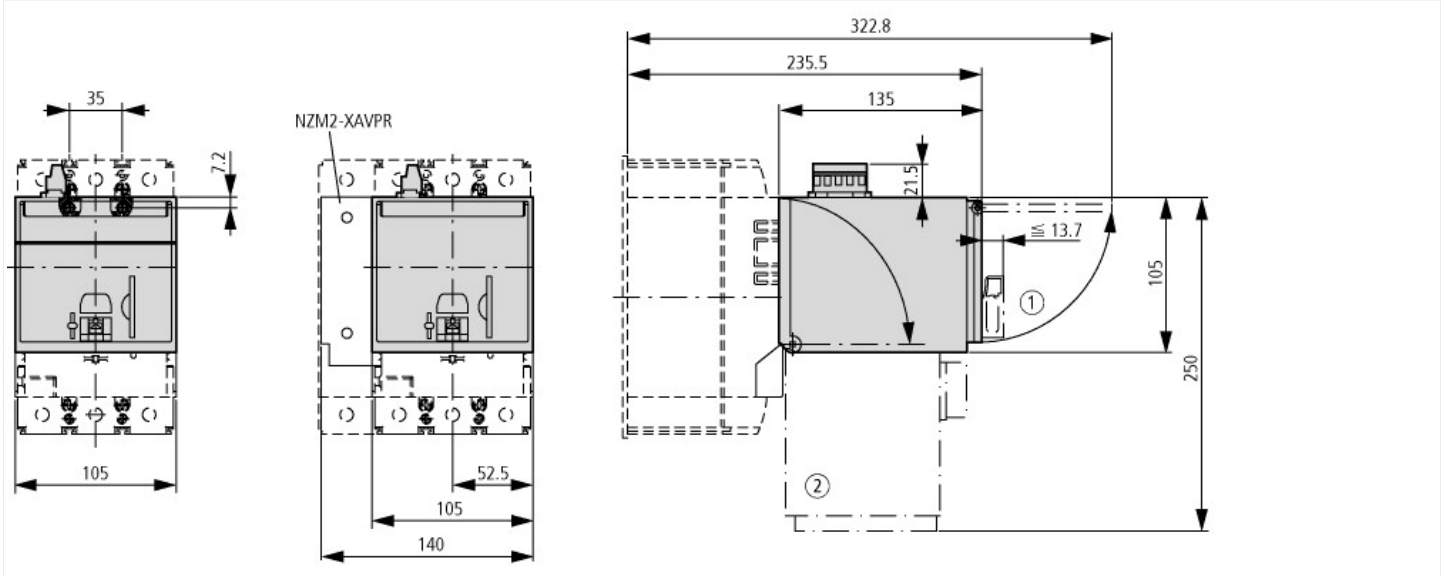

Additional product information (links)

IL01206002Z (AWA1230-1984) NZM2 remote operator

IL01206002Z (AWA1230-1984) NZM2 remote operator

ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01206002Z2016_06.pdf

2/3-wire control and circuit diagrams

<http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.153>